


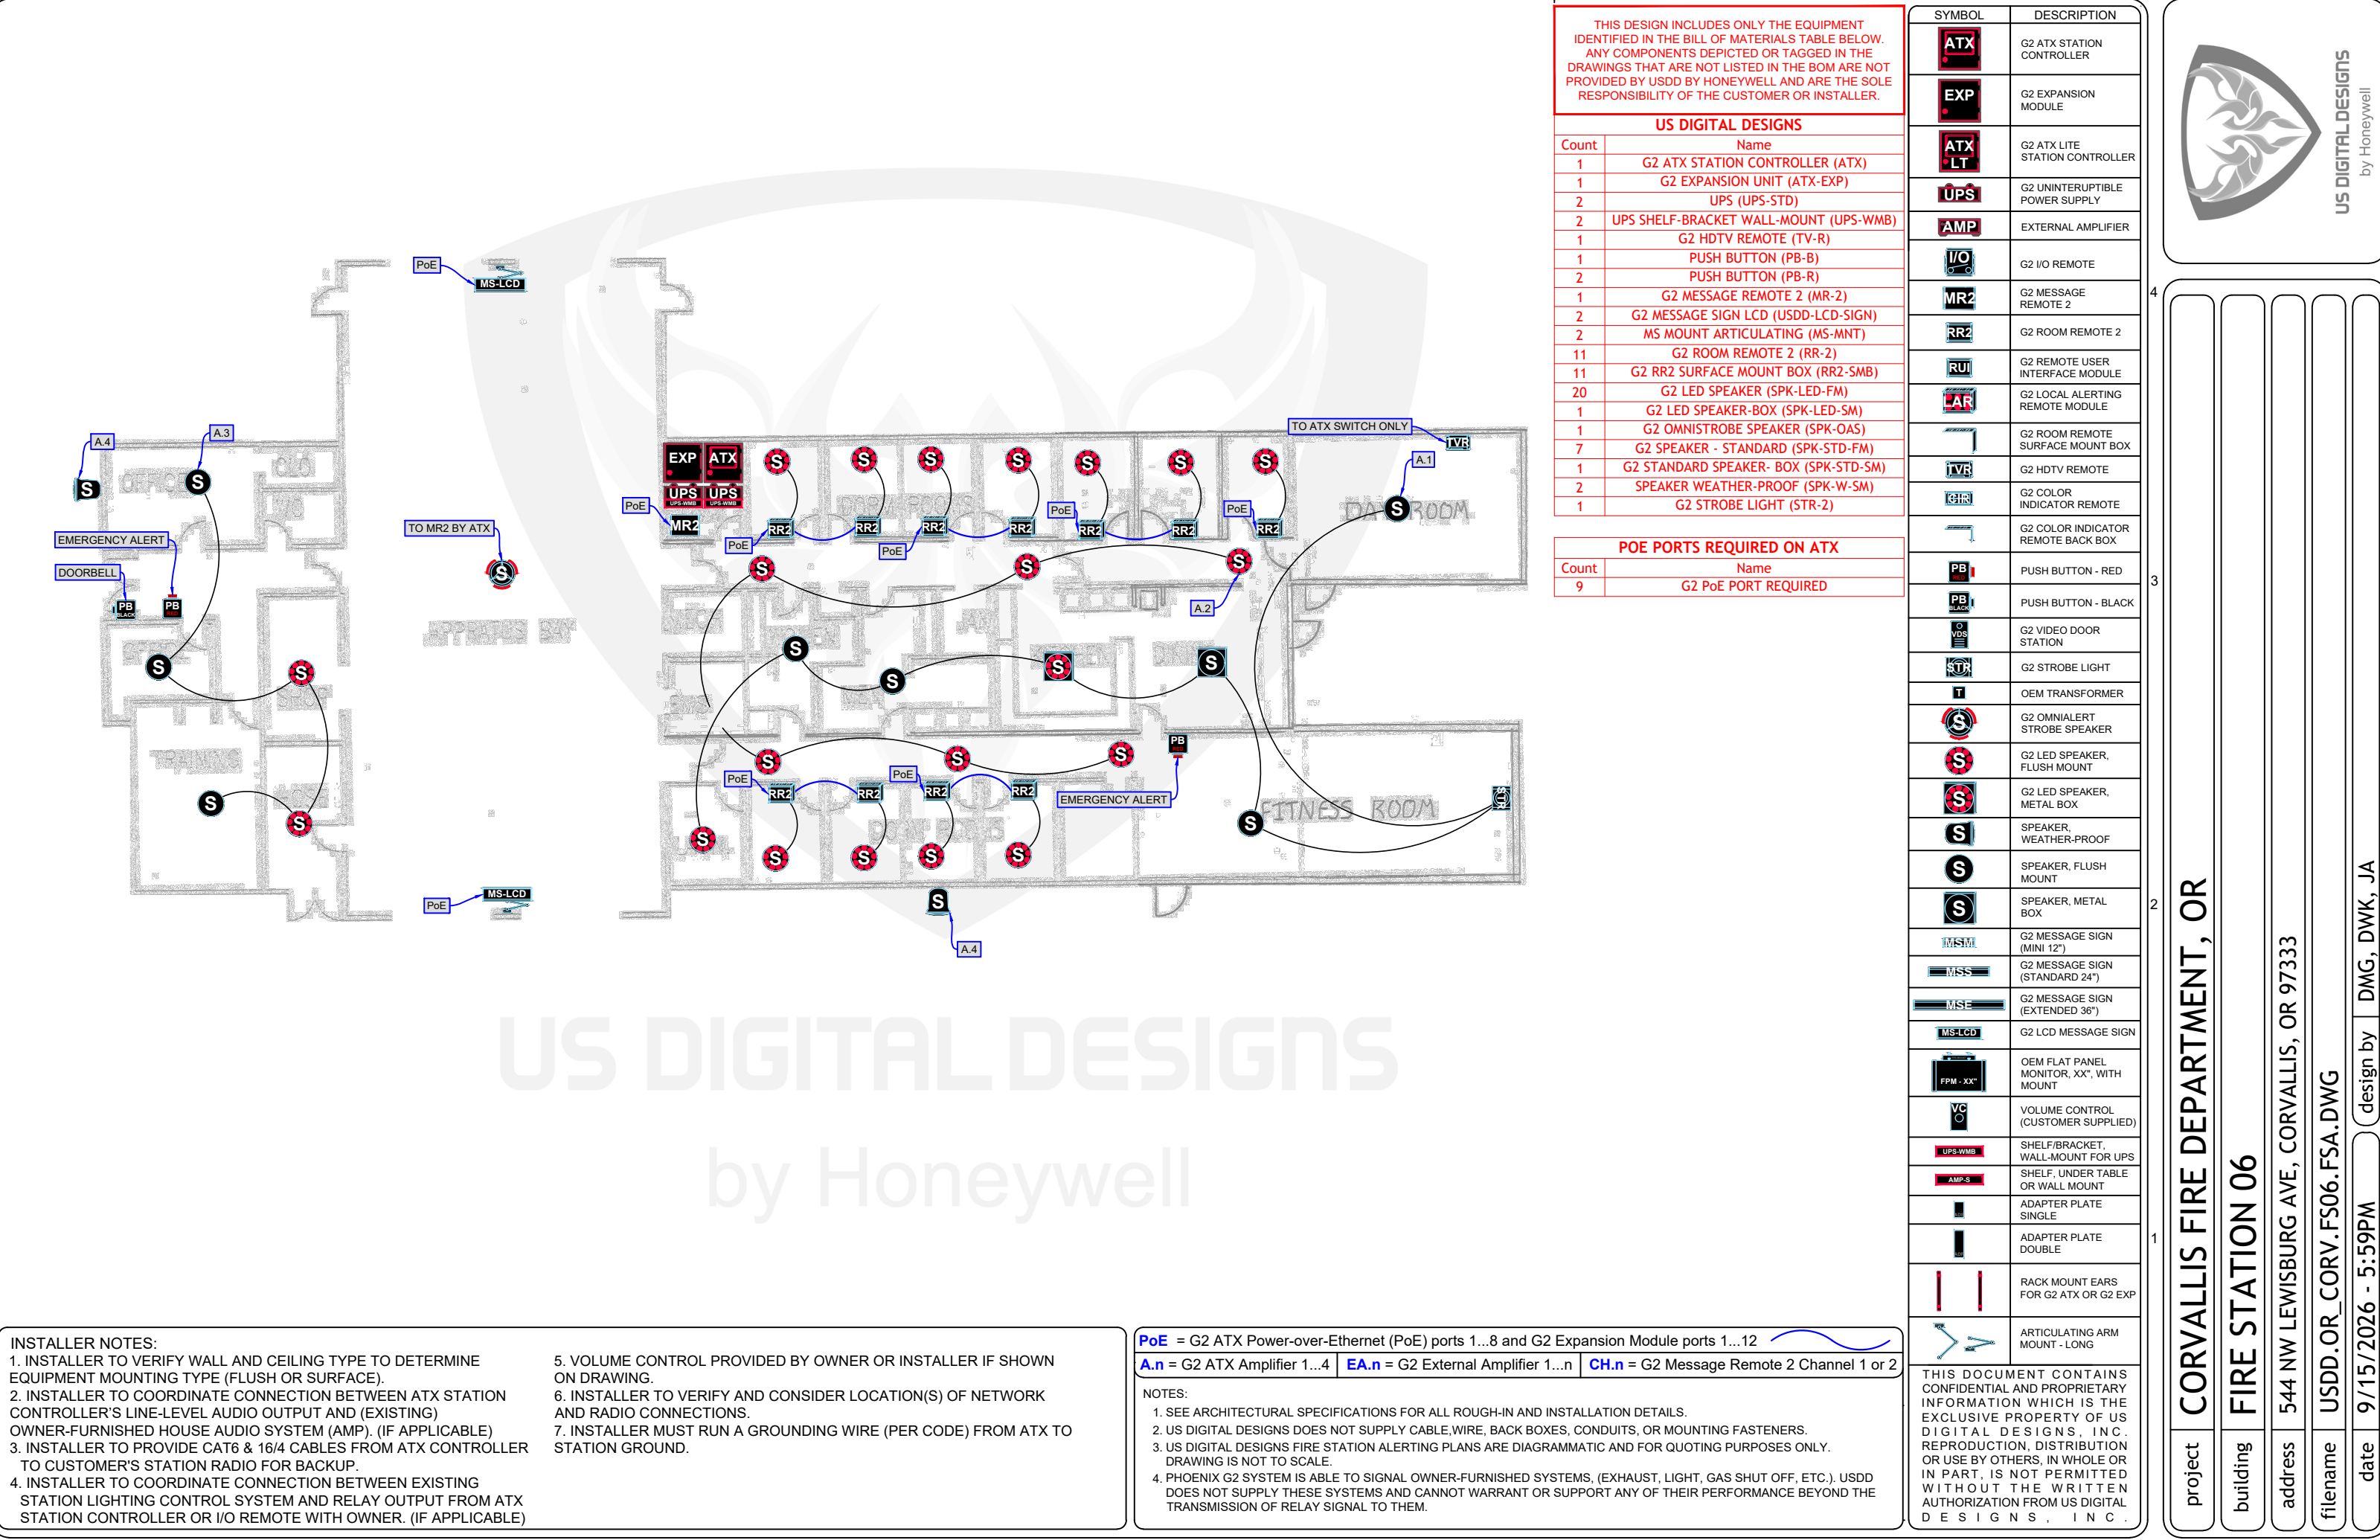

INSTALLER NOTES:

1. INSTALLER TO VERIFY WALL AND CEILING TYPE TO DETERMINE EQUIPMENT MOUNTING TYPE (FLUSH OR SURFACE).

2. INSTALLER TO COORDINATE CONNECTION BETWEEN ATX STATION CONTROLLER'S LINE-LEVEL AUDIO OUTPUT AND (EXISTING) OWNER-FURNISHED HOUSE AUDIO SYSTEM (AMP). (IF APPLICABLE)

3. INSTALLER TO PROVIDE CAT6 & 16/4 CABLES FROM ATX CONTROLLER TO CUSTOMER'S STATION RADIO FOR BACKUP.

4. INSTALLER TO COORDINATE CONNECTION BETWEEN EXISTING STATION LIGHTING CONTROL SYSTEM AND RELAY OUTPUT FROM ATX STATION CONTROLLER OR I/O REMOTE WITH OWNER. (IF APPLICABLE)

5. VOLUME CONTROL PROVIDED BY OWNER OR INSTALLER IF SHOWN ON DRAWING.

6. INSTALLER TO VERIFY AND CONSIDER LOCATION(S) OF NETWORK AND RADIO CONNECTIONS.

7. INSTALLER MUST RUN A GROUNDING WIRE (PER CODE) FROM ATX TO STATION GROUND.

PoE = G2 ATX Power-over-Ethernet (PoE) ports 1...8 and G2 Expansion Module ports 1...12

A.n = G2 ATX Amplifier 1...4 **EA.n** = G2 External Amplifier 1...n **CH.n** = G2 Message Remote 2 Channel 1 or 2

NOTES:

1. SEE ARCHITECTURAL SPECIFICATIONS FOR ALL ROUGH-IN AND INSTALLATION DETAILS.

2. US DIGITAL DESIGNS DOES NOT SUPPLY CABLE, WIRE, BACK BOXES, CONDUITS, OR MOUNTING FASTENERS.

3. US DIGITAL DESIGNS FIRE STATION ALERTING PLANS ARE DIAGRAMMATIC AND FOR QUOTING PURPOSES ONLY. DRAWING IS NOT TO SCALE.

4. PHOENIX G2 SYSTEM IS ABLE TO SIGNAL OWNER-FURNISHED SYSTEMS, (EXHAUST, LIGHT, GAS SHUT OFF, ETC.). USDD DOES NOT SUPPLY THESE SYSTEMS AND CANNOT WARRANT OR SUPPORT ANY OF THEIR PERFORMANCE BEYOND THE TRANSMISSION OF RELAY SIGNAL TO THEM.

THIS DESIGN INCLUDES ONLY THE EQUIPMENT IDENTIFIED IN THE BILL OF MATERIALS TABLE BELOW. ANY COMPONENTS DEPICTED OR TAGGED IN THE DRAWINGS THAT ARE NOT LISTED IN THE BOM ARE NOT PROVIDED BY USDD BY HONEYWELL AND ARE THE SOLE RESPONSIBILITY OF THE CUSTOMER OR INSTALLER.	
US DIGITAL DESIGNS	
Count	Name
1	G2 ATX STATION CONTROLLER (ATX)
1	G2 EXPANSION UNIT (ATX-EXP)
2	UPS (UPS-STD)
2	UPS SHELF-BRACKET WALL-MOUNT (UPS-WMB)
1	G2 HDTV REMOTE (TV-R)
1	PUSH BUTTON (PB-B)
2	PUSH BUTTON (PB-R)
1	G2 MESSAGE REMOTE 2 (MR-2)
2	G2 MESSAGE SIGN LCD (USDD-LCD-SIGN)
2	MS MOUNT ARTICULATING (MS-MNT)
11	G2 ROOM REMOTE 2 (RR-2)
11	G2 RR2 SURFACE MOUNT BOX (RR2-SMB)
20	G2 LED SPEAKER (SPK-LED-FM)
1	G2 LED SPEAKER-BOX (SPK-LED-SM)
1	G2 OMNISTROBE SPEAKER (SPK-OAS)
7	G2 SPEAKER - STANDARD (SPK-STD-FM)
1	G2 STANDARD SPEAKER- BOX (SPK-STD-SM)
2	SPEAKER WEATHER-PROOF (SPK-W-SM)
1	G2 STROBE LIGHT (STR-2)

POE PORTS REQUIRED ON ATX	
Count	Name
9	G2 PoE PORT REQUIRED

SYMBOL	DESCRIPTION
	G2 ATX STATION CONTROLLER
	G2 EXPANSION MODULE
	G2 ATX LITE STATION CONTROLLER
	G2 UNINTERUPTIBLE POWER SUPPLY
	EXTERNAL AMPLIFIER
	G2 I/O REMOTE
	G2 MESSAGE REMOTE 2
	G2 ROOM REMOTE 2
	G2 REMOTE USER INTERFACE MODULE
	G2 LOCAL ALERTING REMOTE MODULE
	G2 HDTV REMOTE
	G2 STROBE LIGHT
	PUSH BUTTON - RED
	PUSH BUTTON - BLACK
	G2 STROBE LIGHT
	OEM TRANSFORMER
	G2 OMNIALERT STROBE SPEAKER
	G2 LED SPEAKER, FLUSH MOUNT
	G2 LED SPEAKER, METAL BOX
	SPEAKER, WEATHER-PROOF
	SPEAKER, FLUSH MOUNT
	SPEAKER, METAL BOX
	G2 MESSAGE SIGN (MINI 12")
	G2 MESSAGE SIGN (STANDARD 24")
	G2 MESSAGE SIGN (EXTENDED 36")
	G2 LCD MESSAGE SIGN
	OEM FLAT PANEL MONITOR, XX", WITH MOUNT
	VOLUME CONTROL (CUSTOMER SUPPLIED)
	SHELF/BRACKET, WALL-MOUNT FOR UPS
	SHELF, UNDER TABLE OR WALL MOUNT
	ADAPTER PLATE SINGLE
	ADAPTER PLATE DOUBLE
	RACK MOUNT EARS FOR G2 ATX OR G2 EXP
	ARTICULATING ARM MOUNT - LONG

THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION WHICH IS THE EXCLUSIVE PROPERTY OF US DIGITAL DESIGNS, INC. REPRODUCTION, DISTRIBUTION OR USE BY OTHERS, IN WHOLE OR IN PART, IS NOT PERMITTED WITHOUT THE WRITTEN AUTHORIZATION FROM US DIGITAL DESIGNS, INC.

project

building

address

filename

date

CORVALLIS FIRE DEPARTMENT, OR

FIRE STATION 06

544 NW LEWISBURG AVE, CORVALLIS, OR 97333

USDD.OR_CORV_FS06.FSA.DWG

9/15/2026 - 5:59PM

design by

DMG, DWK, JA